


TOP VIEW

NOTE:

1. ALL JOINTS BETWEEN POINT (A) & POINT (B) IS TO BE MEGALUG MECHANICALLY RESTRAINED JOINTS. SEE SECTION 02224 PART 2 2.04 FOR INSIDE CASING.
2. ALL 45° BENDS SHALL BE ROLLED TO ACHIEVE 5' HORIZONTAL OFF SET.
3. THIS TYPE OF LOOPING SHALL BE APPROVED BY PUBLIC UTILITIES PRIOR TO INSTALLATION
4. FOR PVC C900 PIPE, MECHANICAL JOINTS SHALL BE ROMAC GRIP RING.

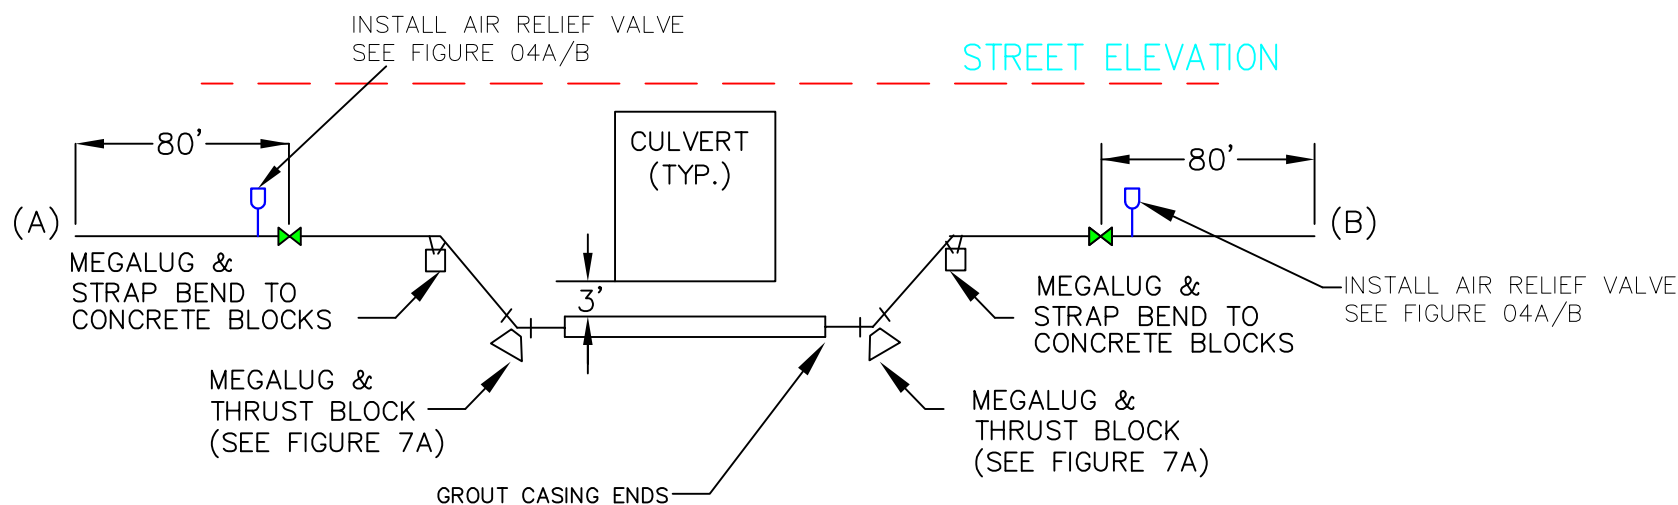

SIDE VIEW

1	RSS	UPDATE	12/1999
2	CC	UPDATE	1/2010
3	CC	UPDATE	5/2013
4	CC	UPDATE	2/2016



STANDARD DETAIL
FIGURE 06A
STEEL CASING WATER LOOP
TYPICAL INSTALLATION

SCALE: NONE

NO.	AUTHORIZED BY	REVISIONS	DATE
-----	---------------	-----------	------